

EXHIBIT K: HEALTH AND SAFETY IMPACTS OF SOLAR PHOTOVOLTAICS (BY OTHERS)

CONFIDENTIAL

WHITE PAPER

Health and Safety Impacts of Solar Photovoltaics

By Tommy Cleveland
May 2017



Contents

1.1 • Project Installation / Construction.....	4
1.2 • System Components 1.2.1 Solar Panels: Construction and Durability.....	5
1.2.2 • Photovoltaic (PV) Technologies.....	7
1.2.3. • Panel End-of-Life Management.....	10
1.2.4 • Non-Panel System Components (racking, wiring, inverter, transformer)..	12
1.4 • Operations and Maintenance – Panel Washing and Vegetation Control....	13
2 • Electromagnetic Fields (EMF).....	14
3 • Electric Shock and Arc Flash Hazards	16
4 • Fire Safety.....	16
Summary.....	17



Health and Safety Impacts of Solar Photovoltaics

The increasing presence of utility-scale solar photovoltaic (PV) systems (sometimes referred to as solar farms) is a rather new development in North Carolina's landscape. Due to the new and unknown nature of this technology, it is natural for communities near such developments to be concerned about health and safety impacts. Unfortunately, the quick emergence of utility-scale solar has cultivated fertile grounds for myths and half-truths about the health impacts of this technology, which can lead to unnecessary fear and conflict.

Photovoltaic (PV) technologies and solar inverters are not known to pose any significant health dangers to their neighbors. The most important dangers posed are increased highway traffic during the relative short construction period and dangers posed to trespassers of contact with high voltage equipment. This latter risk is mitigated by signage and the security measures that industry uses to deter trespassing. As will be discussed in more detail below, risks of site contamination are much less than for most other industrial uses because PV technologies employ few toxic chemicals and those used are used in very small quantities. Due to the reduction in the pollution from fossil-fuel-fired electric generators, the overall impact of solar development on human health is overwhelmingly positive. This pollution reduction results from a partial replacement of fossil-fuel fired generation by emission-free PV-generated electricity, which reduces harmful sulfur dioxide (SO₂), nitrogen oxides (NO_x), and fine particulate matter (PM_{2.5}). Analysis from the National Renewable Energy Laboratory and the Lawrence Berkeley National Laboratory, both affiliates of the U.S. Department of Energy, estimates the health-related air quality benefits to the southeast region from solar PV generators to be worth 8.0 ¢ per kilowatt-hour of solar generation.¹

This is in addition to the value of the electricity and suggests that the air quality benefits of solar are worth more than the electricity itself.

Even though we have only recently seen large-scale installation of PV technologies, the technology and its potential impacts have been studied since the 1950s. A combination of this solar-specific research and general scientific research has led to the scientific community having a good understanding of the science behind potential health and safety impacts of solar energy. This paper utilizes the latest scientific literature and knowledge of solar practices in N.C. to address the health and safety risks associated with solar PV technology. These risks are extremely small, far less than those associated with common activities such as driving a car, and vastly outweighed by health benefits of the generation of clean electricity.

This paper addresses the potential health and safety impacts of solar PV development in North Carolina, organized into the following four categories:

- (1) Hazardous Materials
- (2) Electromagnetic Fields (EMF)
- (3) Electric Shock and Arc Flash
- (4) Fire Safety

1 • Hazardous Materials

One of the more common concerns towards solar is that the panels (referred to as "modules" in the solar industry) consist of toxic materials that endanger public health. However, as shown in this section, solar energy systems may contain small amounts of toxic materials, but these materials do not endanger public health. To understand potential toxic hazards coming from a solar project, one

must understand system installation, materials used, the panel end-of-life protocols, and system operation. This section will examine these aspects of a solar farm and the potential for toxicity impacts in the following subsections:

- (1.2) Project Installation/Construction
 - (1.2) System Components
 - 1.2.1 Solar Panels: Construction and Durability
 - 1.2.2 Photovoltaic technologies
 - (a) Crystalline Silicon
 - (b) Cadmium Telluride (CdTe)
 - (c) CIS/CIGS
 - 1.2.3 Panel End of Life Management
 - 1.2.4 Non-panel System Components
 - (1.3) Operations and Maintenance

1.1 Project Installation/Construction

The system installation, or construction, process does not require toxic chemicals or processes. The site is mechanically cleared of large vegetation, fences are constructed, and the land is surveyed to layout exact installation locations. Trenches for underground wiring are dug and support posts are driven into the ground. The solar panels are bolted to steel and aluminum support structures and wired together. Inverter pads are installed, and an inverter and transformer are installed on each pad. Once everything is connected, the system is tested, and only then turned on.



Figure 1: Utility-scale solar facility (5 MWAC) located in Catawba County. Source: Strata Solar

1.2 • System Components

1.2.1 Solar Panels: Construction and Durability

Solar PV panels typically consist of glass, polymer, aluminum, copper, and semiconductor materials that can be recovered and recycled at the end of their useful life.² Today there are two PV technologies used in PV panels at utility-scale solar facilities, silicon, and thin film. As of 2016, all thin film used in North Carolina solar facilities are cadmium telluride (CdTe) panels from the US manufacturer First Solar, but there are other thin film PV panels available on the market, such as Solar Frontier's CIGS panels. Crystalline silicon technology consists of silicon wafers which are made into cells

and assembled into panels, thin film technologies consist of thin layers of semiconductor material deposited onto glass, polymer or metal substrates. While there are differences in the components and manufacturing processes of these two types of solar technologies, many aspects of their PV panel construction are very similar. Specifics about each type of PV chemistry as it relates to toxicity are covered in subsections a, b, and c in section 1.2.2; on crystalline silicon, cadmium telluride, and CIS/CIGS respectively. The rest of this section applies equally to both silicon and thin film panels.

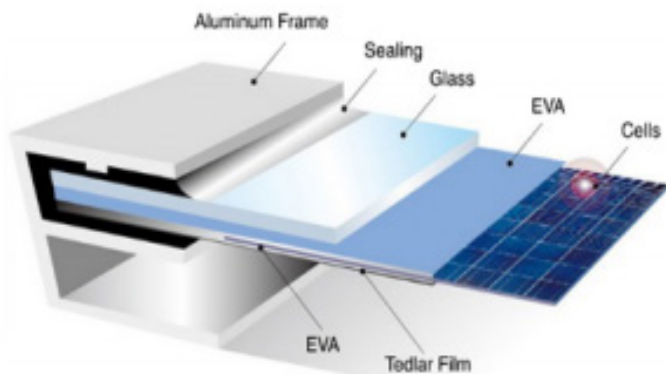


Figure 2: Components of crystalline silicon panels. The vast majority of silicon panels consist of a glass sheet on the topside with an aluminum frame providing structural support. Image Source: www.riteksolar.com.tw

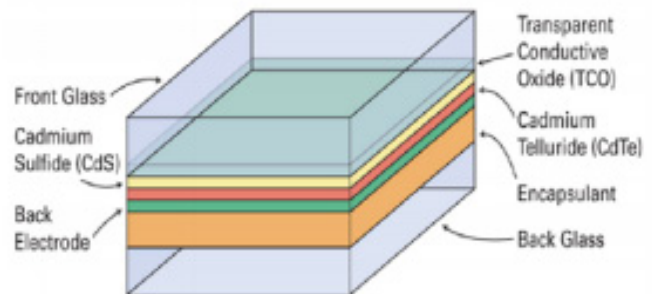


Figure 3: Layers of a common frameless thin-film panel (CdTe). Many thin film panels are frameless, including the most common thin-film panels, First Solar's CdTe. Frameless panels have protective glass on both the front and back of the panel. Layer thicknesses not to scale. Image Source: www.homepower.com

To provide decades of corrosion-free operation, PV cells in PV panels are encapsulated from air and moisture between two layers of plastic. The encapsulation layers are protected on the top with a layer of tempered glass and on the backside with a polymer sheet. Frameless modules include a protective layer of glass on the rear of the panel, which may also be tempered. The plastic ethylene-vinyl acetate (EVA) commonly provides the

cell encapsulation. For decades, this same material has been used between layers of tempered glass to give car windshields and hurricane windows their great strength. In the same way that a car windshield cracks but stays intact, the EVA layers in PV panels keep broken panels intact (see Figure 4). Thus, a damaged module does not generally create small pieces of debris; instead, it largely remains together as one piece.



Figure 4: The mangled PV panels in this picture illustrate the nature of broken solar panels; the glass cracks but the panel is still in one piece. Image Source: http://img.alibaba.com/photo/115259576/broken_solar_panel.jpg

PV panels constructed with the same basic components as modern panels have been installed across the globe for well over thirty years.³ The long-term durability and performance demonstrated over these decades, as well as the results of accelerated lifetime testing, helped lead to an industry standard 25-year power production warranty for PV panels. These power warranties warrant a PV panel to produce at least 80% of their original nameplate production after 25 years of use. A recent SolarCity and DNV GL study reported that today's quality PV panels should be expected to reliably and efficiently produce power for thirty-five years.⁴

Local building codes require all structures, including ground mounted solar arrays, to be engineered to withstand anticipated wind speeds, as defined by the local wind speed requirements. Many rack-

ing products are available in versions engineered for wind speeds of up to 150 miles per hour, which is significantly higher than the wind speed requirement anywhere in North Carolina. The strength of PV mounting structures were demonstrated during Hurricane Sandy in 2012 and again during Hurricane Matthew in 2016. During Hurricane Sandy, the many large-scale solar facilities in New Jersey and New York at that time suffered only minor damage.⁵ In the fall of 2016, the US and Caribbean experienced destructive winds and torrential rains from Hurricane Matthew, yet one leading solar tracker manufacturer reported that their numerous systems in the impacted area received zero damage from wind or flooding.⁶

In the event of a catastrophic event capable of damaging solar equipment, such as a tornado, the system will almost certainly have property insurance

that will cover the cost to cleanup and repair the project. It is in the best interest of the system owner to protect their investment against such risks. It is also in their interest to get the project repaired and producing full power as soon as possible. Therefore, the investment in adequate insurance is a wise business practice for the system owner. For the same reasons, adequate insurance coverage is also generally a requirement of the bank or firm providing financing for the project.

1.2.2 Photovoltaic (PV) Technologies

a. Crystalline Silicon

This subsection explores the toxicity of silicon-based PV panels and concludes that they do not pose a material risk of toxicity to public health and safety. Modern crystalline silicon PV panels, which account for over 90% of solar PV panels installed today, are, more or less, a commodity product. The overwhelming majority of panels installed in North Carolina are crystalline silicon panels that are informally classified as Tier I panels. Tier I panels are from well-respected manufacturers that have a good chance of being able to honor warranty claims. Tier I panels are understood to be of high quality, with predictable performance, durability, and content. Well over 80% (by weight) of the content of a PV panel is the tempered glass front and the aluminum frame, both of which are common building materials. Most of the remaining portion are common plastics, including polyethylene terephthalate in the backsheet, EVA encapsulation of the PV cells, polyphenyl ether in the junction box, and polyethylene insulation on the wire leads. The active, working components of the system are the silicon photovoltaic cells, the small electrical leads connecting them together, and to the wires coming out of the back of the panel. The electricity generating and conducting components makeup less than 5% of the weight

of most panels. The PV cell itself is nearly 100% silicon, and silicon is the second most common element in the Earth's crust. The silicon for PV cells is obtained by high-temperature processing of quartz sand (SiO_2) that removes its oxygen molecules. The refined silicon is converted to a PV cell by adding extremely small amounts of boron and phosphorus, both of which are common and of very low toxicity.

The other minor components of the PV cell are also generally benign; however, some contain lead, which is a human toxicant that is particularly harmful to young children. The minor components include an extremely thin antireflective coating (silicon nitride or titanium dioxide), a thin layer of aluminum on the rear, and thin strips of silver alloy that are screen-printed on the front and rear of cell.⁷ In order for the front and rear electrodes to make effective electrical contact with the proper layer of the PV cell, other materials (called glass frit) are mixed with the silver alloy and then heated to etch the metals into the cell. This glass frit historically contains a small amount of lead (Pb) in the form of lead oxide. The 60 or 72 PV cells in a PV panel are connected by soldering thin solder-covered copper tabs from the back of one cell to the front of the next cell. Traditionally a tin-based solder containing some lead (Pb) is used, but some manufacturers have switched to lead-free solder. The glass frit and/or the solder may contain trace amounts of other metals, potentially including some with human toxicity such as cadmium. However, testing to simulate the potential for leaching from broken panels, which is discussed in more detail below, did not find a potential toxicity threat from these trace elements. Therefore, the tiny amount of lead in the glass frit and the solder is the only part of silicon PV panels with a potential to create a negative health impact. However, as described below, the very limited amount of lead involved and its strong physical and chemical attachment to other components of the PV panel means that even in worst-case scenarios the health hazard it poses is insignificant.

As with many electronic industries, the solder in silicon PV panels has historically been a lead-based solder, often 36% lead, due to the superior properties of such solder. However, recent advances in lead-free solders have spurred a trend among PV panel manufacturers to reduce or remove the lead in their panels. According to the 2015 Solar Scorecard from the Silicon Valley Toxics Coalition, a group that tracks environmental responsibility of photovoltaic panel manufacturers, fourteen companies (increased from twelve companies in 2014) manufacture PV panels certified to meet the European Restriction of Hazardous Substances (RoHS) standard. This means that the amount of cadmium and lead in the panels they manufacture fall below the RoHS thresholds, which are set by the European Union and serve as the world's de facto standard for hazardous substances in manufactured goods.⁸ The Restriction of Hazardous Substances (RoHS) standard requires that the maximum concentration found in any homogeneous material in a product is less than 0.01% cadmium and less than 0.10% lead, therefore, any solder can be no more than 0.10% lead.⁹

While some manufacturers are producing PV panels that meet the RoHS standard, there is no requirement that they do so because the RoHS Directive explicitly states that the directive does not apply to photovoltaic panels.¹⁰ The justification for this is provided in item 17 of the current RoHS Directive: "The development of renewable forms of energy is one of the Union's key objectives, and the contribution made by renewable energy sources to environmental and climate objectives is crucial. Directive 2009/28/EC of the European Parliament and of the Council of 23 April 2009 on the promotion of the use of energy from renewable sources (4) recalls that there should be coherence between those objectives and other Union environmental legislation. Consequently, this Directive should not prevent the development of renewable energy technologies that have no negative impact on health and the environment and that are sustainable and economically viable."

The use of lead is common in our modern economy. However, only about 0.5% of the annual lead consumption in the U.S. is for electronic solder for all uses; PV solder makes up only a tiny portion of this 0.5%. Close to 90% of lead consumption in the US is in batteries, which do not encapsulate the pounds of lead contained in each typical automotive battery. This puts the lead in batteries at great risk of leaching into the environment. Estimates for the lead in a single PV panel with lead-based solder range from 1.6 to 24 grams of lead, with 13g (less than half of an ounce) per panel seen most often in the literature.¹¹ At 13 g/panel¹², each panel contains one-half of the lead in a typical 12-gauge shotgun shell. This amount equates to roughly 1/750th of the lead in a single car battery. In a panel, it is all durably encapsulated from air or water for the full life of the panel.¹⁴

As indicated by their 20 to 30-year power warranty, PV modules are designed for a long service life, generally over 25 years. For a panel to comply with its 25-year power warranty, its internal components, including lead, must be sealed from any moisture. Otherwise, they would corrode and the panel's output would fall below power warranty levels. Thus, the lead in operating PV modules is not at risk of release to the environment during their service lifetime. In extreme experiments, researchers have shown that lead can leach from crushed or pulverized panels.^{15, 16} However, more real-world tests designed to represent typical trash compaction that are used to classify waste as hazardous or non-hazardous show no danger from leaching.^{17,18} For more information about PV panel end-of-life, see the Panel Disposal section.

As illustrated throughout this section, silicon-based PV panels do not pose a material threat to public health and safety. The only aspect of the panels with potential toxicity concerns is the very small amount of lead in some panels. However, any lead in a panel is well sealed from environmental exposure for the operating lifetime of the solar panel and thus not at risk of release into the environment.

b. Cadmium Telluride (CdTe) PV Panels

This subsection examines the components of a cadmium telluride (CdTe) PV panel. Research demonstrates that they pose negligible toxicity risk to public health and safety while significantly reducing the public's exposure to cadmium by reducing coal emissions. As of mid-2016, a few hundred MWs of cadmium telluride (CdTe) panels, all manufactured by the U.S. company First Solar, have been installed in North Carolina.

Questions about the potential health and environmental impacts from the use of this PV technology are related to the concern that these panels contain cadmium, a toxic heavy metal. However, scientific studies have shown that cadmium telluride differs from cadmium due to its high chemical and thermal stability.¹⁹ Research has shown that the tiny amount of cadmium in these panels does not pose a health or safety risk.²⁰ Further, there are very compelling reasons to welcome its adoption due to reductions in unhealthy pollution associated with burning coal. Every GWh of electricity generated by burning coal produces about 4 grams of cadmium air emissions.²¹ Even though North Carolina produces a significant fraction of our electricity from coal, electricity from solar offsets much more natural gas than coal due to natural gas plants being able to adjust their rate of production more easily and quickly. If solar electricity offsets 90% natural gas and 10% coal, each 5-megawatt (5 MWAC, which is generally 7 MWDC) CdTe solar facility in North Carolina keeps about 157 grams, or about a third of a pound, of cadmium *out* of our environment.^{22, 23}

Cadmium is toxic, but all the approximately 7 grams of cadmium in one CdTe panel is in the form of a chemical compound cadmium telluride,²⁴ which has 1/100th the toxicity of free cadmium.²⁵ Cadmium telluride is a very stable compound that is non-volatile and non-soluble in water. Even in the case of a fire, research shows that less than 0.1% of the cadmium is released when a CdTe

panel is exposed to fire. The fire melts the glass and encapsulates over 99.9% of the cadmium in the molten glass.²⁷

It is important to understand the source of the cadmium used to manufacture CdTe PV panels. The cadmium is a byproduct of zinc and lead refining. The element is collected from emissions and waste streams during the production of these metals and combined with tellurium to create the CdTe used in PV panels. If the cadmium were not collected for use in the PV panels or other products, it would otherwise either be stockpiled for future use, cemented and buried, or disposed of.²⁸ Nearly all the cadmium in old or broken panels can be recycled which can eventually serve as the primary source of cadmium for new PV panels.²⁹

Similar to silicon-based PV panels, CdTe panels are constructed of a tempered glass front, one instead of two clear plastic encapsulation layers, and a rear heat strengthened glass backing (together >98% by weight). The final product is built to withstand exposure to the elements without significant damage for over 25 years. While not representative of damage that may occur in the field or even at a landfill, laboratory evidence has illustrated that when panels are ground into a fine powder, very acidic water is able to leach portions of the cadmium and tellurium,³⁰ similar to the process used to recycle CdTe panels. Like many silicon-based panels, CdTe panels are reported (as far back as 1998³¹ to pass the EPA's Toxic Characteristic Leaching Procedure (TCLP) test, which tests the potential for crushed panels in a landfill to leach hazardous substances into groundwater.³² Passing this test means that they are classified as non-hazardous waste and can be deposited in landfills.^{33,34} For more information about PV panel end-of-life, see the Panel Disposal section.

There is also concern of environmental impact resulting from potential catastrophic events involving CdTe PV panels. An analysis of worst-case scenarios for environmental impact from CdTe PV

panels, including earthquakes, fires, and floods, was conducted by the University of Tokyo in 2013. After reviewing the extensive international body of research on CdTe PV technology, their report concluded, “Even in the worst-case scenarios, it is unlikely that the Cd concentrations in air and sea water will exceed the environmental regulation values.”³⁵ In a worst-case scenario of damaged panels abandoned on the ground, insignificant amounts of cadmium will leach from the panels. This is because this scenario is much less conducive (larger module pieces, less acidity) to leaching than the conditions of the EPA’s TCLP test used to simulate landfill conditions, which CdTe panels pass.³⁶

First Solar, a U.S. company, and the only significant supplier of CdTe panels, has a robust panel take-back and recycling program that has been operating commercially since 2005.³⁷ The company states that it is “committed to providing a commercially attractive recycling solution for photovoltaic (PV) power plant and module owners to help them meet their module (end of life) EOL obligation simply, costeffectively and responsibly.” First Solar global recycling services to their customers to collect and recycle panels once they reach the end of productive life whether due to age or damage. These recycling service agreements are structured to be financially attractive to both First Solar and the solar panel owner. For First Solar, the contract provides the company with an affordable source of raw materials needed for new panels and presumably a diminished risk of undesired release of Cd. The contract also benefits the solar panel owner by allowing them to avoid tipping fees at a waste disposal site. The legal contract helps provide peace of mind by ensuring compliance by both parties when considering the continuing trend of rising disposal costs and increasing regulatory requirements.

c. CIS/CIGS and other PV technologies

Copper indium gallium selenide PV technology, of-

ten referred to as CIGS, is the second most common type of thin-film PV panel but a distant second behind CdTe. CIGS cells are composed of a thin layer of copper, indium, gallium, and selenium on a glass or plastic backing. None of these elements are very toxic, although selenium is a regulated metal under the Federal Resource Conservation and Recovery Act (RCRA).³⁸ The cells often also have an extremely thin layer of cadmium sulfide that contains a tiny amount of cadmium, which is toxic. The promise of high efficiency CIGS panels drove heavy investment in this technology in the past. However, researchers have struggled to transfer high efficiency success in the lab to low-cost full-scale panels in the field.³⁹ Recently, a CIGS manufacturer based in Japan, Solar Frontier, has achieved some market success with a rigid, glass-faced CIGS module that competes with silicon panels. Solar Frontier produces the majority of CIS panels on the market today.⁴⁰ Notably, these panels are RoHS compliant,⁴¹ thus meeting the rigorous toxicity standard adopted by the European Union even though this directive exempts PV panels. The authors are unaware of any completed or proposed utility-scale system in North Carolina using CIS/CIGS panels.

1.2.3 Panel End-of-Life Management

Concerns about the volume, disposal, toxicity, and recycling of PV panels are addressed in this subsection. To put the volume of PV waste into perspective, consider that by 2050, when PV systems installed in 2020 will reach the end of their lives, it is estimated that the global annual PV panel waste tonnage will be 10% of the 2014 global e-waste tonnage.⁴² In the U.S., end-of-life disposal of solar products is governed by the Federal Resource Conservation and Recovery Act (RCRA), as well as state policies in some situations. RCRA separates waste into hazardous (not accepted at ordinary landfill) and solid waste (generally accepted

at ordinary landfill) based on a series of rules. According to RCRA, the way to determine if a PV panel is classified as hazardous waste is the Toxic Characteristic Leaching Procedure (TCLP) test. This EPA test is designed to simulate landfill disposal and determine the risk of hazardous substances leaching out of the landfill.^{43,44,45} Multiple sources report that most modern PV panels (both crystalline silicon and cadmium telluride) pass the TCLP test.^{46,47} Some studies found that some older (1990s) crystalline silicon panels, and perhaps some newer crystalline silicon panels (specifics are not given about vintage of panels tested), do not pass the lead (Pb) leachate limits in the TCLP test.^{48,49}

The test begins with the crushing of a panel into centimeter-sized pieces. The pieces are then mixed in an acid bath. After tumbling for eighteen hours, the fluid is tested for forty hazardous substances that all must be below specific threshold levels to pass the test. Research comparing TCLP conditions to conditions of damaged panels in the field found that simulated landfill conditions provide overly conservative estimates of leaching for field-damaged panels.⁵⁰ Additionally, research in Japan has found no detectable Cd leaching from cracked CdTe panels when exposed to simulated acid rain.⁵¹

Although modern panels can generally be landfilled, they can also be recycled. Even though recent waste volume has not been adequate to support significant PV-specific recycling infrastructure, the existing recycling industry in North Carolina reports that it recycles much of the current small volume of broken PV panels. In an informal survey conducted by the NC Clean Energy Technology Center survey in early 2016, seven of the eight large active North Carolina utility-scale solar developers surveyed reported that they send damaged panels back to the manufacturer and/or to a local recycler. Only one developer reported sending damaged panels to the landfill.

The developers reported at that time that they are usually paid a small amount per panel by local recycling firms. In early 2017, a PV developer reported that a local recycler was charging a small fee per panel to recycle damaged PV panels. The local recycling firm known to authors to accept PV panels described their current PV panel recycling practice as of early 2016 as removing the aluminum frame for local recycling and removing the wire leads for local copper recycling. The remainder of the panel is sent to a facility for processing the non-metallic portions of crushed vehicles, referred to as “fluff” in the recycling industry.⁵² This processing within existing general recycling plants allows for significant material recovery of major components, including glass which is 80% of the module weight, but at lower yields than PV-specific recycling plants. Notably almost half of the material value in a PV panel is in the few grams of silver contained in almost every PV panel produced today. In the long-term, dedicated PV panel recycling plants can increase treatment capacities and maximize revenues resulting in better output quality and the ability to recover a greater fraction of the useful materials.⁵³ PV-specific panel recycling technologies have been researched and implemented to some extent for the past decade, and have been shown to be able to recover over 95% of PV material (semiconductor) and over 90% of the glass in a PV panel.⁵⁴

A look at global PV recycling trends hints at the future possibilities of the practice in our country. Europe installed MW-scale volumes of PV years before the U.S. In 2007, a public-private partnership between the European Union and the solar industry set up a voluntary collection and recycling system called PV CYCLE. This arrangement was later made mandatory under the EU’s WEEE directive, a program for waste electrical and electronic equipment.⁵⁵ Its member companies (PV panel producers) fully finance the association. This makes it possible for end-users to return the member companies’ defective panels for recycling at any of the over 300 collection points around

Europe without added costs. Additionally, PV CYCLE will pick up batches of 40 or more used panels at no cost to the user. This arrangement has been very successful, collecting and recycling over 13,000 tons by the end of 2015.⁵⁶

In 2012, the WEEE Directive added the end-of-life collection and recycling of PV panels to its scope.⁵⁷ This directive is based on the principle of extended-producer-responsibility. It has a global impact because producers that want to sell into the EU market are legally responsible for end-of-life management. Starting in 2018, this directive targets that 85% of PV products “put in the market” in Europe are recovered and 80% is prepared for reuse and recycling.

The success of the PV panel collection and recycling practices in Europe provides promise for the future of recycling in the U.S. In mid-2016, the US Solar Energy Industry Association (SEIA) announced that they are starting a national solar panel recycling program with the guidance and support of many leading PV panel producers.⁵⁸ The program will aggregate the services offered by recycling vendors and PV manufacturers, which will make it easier for consumers to select a cost-effective and environmentally responsible end-of-life management solution for their PV products. According to SEIA, they are planning the program in an effort to make the entire industry landfill-free. In addition to the national recycling network program, the program will provide a portal for system owners and consumers with information on how to responsibly recycle their PV systems.

While a cautious approach toward the potential for negative environmental and/or health impacts from retired PV panels is fully warranted, this section has shown that the positive health impacts of reduced emissions from fossil fuel combustion from PV systems more than outweighs any potential risk. Testing shows that silicon and CdTe panels are both safe to dispose of in landfills, and are also safe in worst case conditions of abandonment or damage in a disaster. Additionally, analysis by local engineers has found that the current salvage

value of the equipment in a utility scale PV facility generally exceeds general contractor estimates for the cost to remove the entire PV system.^{59,60,61}

1.2.4 Non-Panel System Components

(racking, wiring, inverter, transformer)

While previous toxicity subsections discussed PV panels, this subsection describes the non-panel components of utility-scale PV systems and investigates any potential public health and safety concerns. The most significant non-panel component of a ground-mounted PV system is the mounting structure of the rows of panels, commonly referred to as “racking”. The vertical post portion of the racking is galvanized steel and the remaining above-ground racking components are either galvanized steel or aluminum, which are both extremely common and benign building materials. The inverters that make the solar generated electricity ready to send to the grid have weather-proof steel enclosures that protect the working components from the elements. The only fluids that they might contain are associated with their cooling systems, which are not unlike the cooling system in a computer. Many inverters today are RoHS compliant.

The electrical transformers (to boost the inverter output voltage to the voltage of the utility connection point) do contain a liquid cooling oil. However, the fluid used for that function is either a nontoxic mineral oil or a biodegradable non-toxic vegetable oil, such as BIOTEMP from ABB. These vegetable transformer oils have the additional advantage of being much less flammable than traditional mineral oils. Significant health hazards are associated with old transformers containing cooling oil with toxic PCBs. Transformers with PCB-containing oil were common before PCBs were outlawed in the U.S. in 1979. PCBs still exist in older transformers in the field across the country.

Other than a few utility research sites, there are no batteries on- or off-site associated with utility-scale solar energy facilities in North Carolina, avoiding any potential health or safety concerns related to battery technologies. However, as battery technologies continue to improve and prices continue to decline we are likely to start seeing some batteries at solar facilities. Lithium ion batteries currently dominate the world utility-scale battery market, which are not very toxic. No non-panel system components were found to pose any health or environmental dangers.

1.4 Operations and Maintenance – Panel Washing and Vegetation Control

Throughout the eastern U.S., the climate provides frequent and heavy enough rain to keep panels adequately clean. This dependable weather pattern eliminates the need to wash the panels on a regular basis. Some system owners may choose to wash panels as often as once a year to increase production, but most in N.C. do not regularly wash any PV panels. Dirt build up over time may justify panel washing a few times over the panels' lifetime; however, nothing more than soap and water are required for this activity.

The maintenance of ground-mounted PV facilities requires that vegetation be kept low, both for aesthetics and to avoid shading of the PV panels. Several approaches are used to maintain vegetation at NC solar facilities, including planting of limited-height species, mowing, weed-eating, herbicides, and grazing livestock (sheep). The following descriptions of vegetation maintenance practices are based on interviews with several solar developers as well as with three maintenance firms that together are contracted to maintain well over 100

of the solar facilities in N.C. The majority of solar facilities in North Carolina maintain vegetation primarily by mowing. Each row of panels has a single row of supports, allowing sickle mowers to mow under the panels. The sites usually require mowing about once a month during the growing season. Some sites employ sheep to graze the site, which greatly reduces the human effort required to maintain the vegetation and produces high quality lamb meat.⁶²

In addition to mowing and weed eating, solar facilities often use some herbicides. Solar facilities generally do not spray herbicides over the entire acreage; rather they apply them only in strategic locations such as at the base of the perimeter fence, around exterior vegetative buffer, on interior dirt roads, and near the panel support posts. Also unlike many row crop operations, solar facilities generally use only general use herbicides, which are available over the counter, as opposed to restricted use herbicides commonly used in commercial agriculture that require a special restricted use license. The herbicides used at solar facilities are primarily 2-4-D and glyphosate (Round-up®), which are two of the most common herbicides used in lawns, parks, and agriculture across the country. One maintenance firm that was interviewed sprays the grass with a class of herbicide known as a growth regulator in order to slow the growth of grass so that mowing is only required twice a year. Growth regulators are commonly used on highway roadsides and golf courses for the same purpose. A commercial pesticide applicator license is required for anyone other than the landowner to apply herbicides, which helps ensure that all applicators are adequately educated about proper herbicide use and application. The license must be renewed annually and requires passing of a certification exam appropriate to the area in which the applicator wishes to work. Based on the limited data available, it appears that solar facilities in N.C. generally use significantly less herbicides per acre than most commercial agriculture or lawn maintenance services.

2. Electromagnetic Fields (EMF)

PV systems do not emit any material during their operation; however, they do generate electromagnetic fields (EMF), sometimes referred to as radiation. EMF produced by electricity is non-ionizing radiation, meaning the radiation has enough energy to move atoms in a molecule around (experienced as heat), but not enough energy to remove electrons from an atom or molecule (ionize) or to damage DNA. As shown below, modern humans are all exposed to EMF throughout our daily lives without negative health impact. Someone outside of the fenced perimeter of a solar facility is not exposed to significant EMF from the solar facility. Therefore, there is no negative health impact from the EMF produced in a solar farm. The following paragraphs provide some additional background and detail to support this conclusion.

Since the 1970s, some have expressed concern over potential health consequences of EMF from electricity, but no studies have ever shown this EMF to cause health problems.⁶³ These concerns are based on some epidemiological studies that found a slight increase in childhood leukemia associated with average exposure to residential power-frequency magnetic fields above 0.3 to 0.4 μT (microteslas) (equal to 3.0 to 4.0 mG (milligauss)). μT and mG are both units used to measure magnetic field strength. For comparison, the average exposure for people in the U.S. is one mG or 0.1 μT , with about 1% of the population with an average exposure in excess of 0.4 μT (or 4 mG).⁶⁴ These epidemiological studies, which found an association but not a causal relationship, led the World Health Organization's International Agency for Research on Cancer (IARC) to classify ELF magnetic fields as "possibly carcinogenic to humans". Coffee also has this classification. This classification means there is limited evidence but not enough evidence to designate

as either a "probable carcinogen" or "human carcinogen". Overall, there is very little concern that ELF EMF damages public health. The only concern that does exist is for long-term exposure above 0.4 μT (4 mG) that may have some connection to increased cases of childhood leukemia. In 1997, the National Academies of Science were directed by Congress to examine this concern and concluded:

*"Based on a comprehensive evaluation of published studies relating to the effects of power-frequency electric and magnetic fields on cells, tissues, and organisms (including humans), the conclusion of the committee is that the current body of evidence does not show that exposure to these fields presents a human-health hazard. Specifically, no conclusive and consistent evidence shows that exposures to residential electric and magnetic fields produce cancer, adverse neurobehavioral effects, or reproductive and developmental effects."*⁶⁵

There are two aspects to electromagnetic fields, an electric field and a magnetic field. The electric field is generated by voltage and the magnetic field is generated by electric current, i.e., moving electrons. A task group of scientific experts convened by the World Health Organization (WHO) in 2005 concluded that there were no substantive health issues related to electric fields (0 to 100,000 Hz) at levels generally encountered by members of the public.⁶⁶ The relatively low voltages in a solar facility and the fact that electric fields are easily shielded (i.e., blocked) by common materials, such as plastic, metal, or soil means that there is no concern of negative health impacts from the electric fields generated by a solar facility. Thus, the remainder of this section addresses magnetic fields. Magnetic fields are not shielded by most common materials and thus can easily pass through them. Both types of fields are strongest close to the source of electric generation and weaken quickly with distance from the source.

The direct current (DC) electricity produced by PV panels produce stationary (0 Hz) electric and magnetic fields. Because of minimal concern about potential risks of stationary fields, little scientific research has examined stationary fields' impact on human health.⁶⁷ In even the largest PV facilities, the DC voltages and currents are not very high. One can illustrate the weakness of the EMF generated by a PV panel by placing a compass on an operating solar panel and observing that the needle still points north.

While the electricity throughout the majority of a solar site is DC electricity, the inverters convert this DC electricity to alternating current (AC) electricity matching the 60 Hz frequency of the grid. Therefore, the inverters and the wires delivering this power to the grid are producing non-stationary EMF, known as extremely low frequency (ELF) EMF, normally oscillating with a frequency of 60 Hz. This frequency is at the low-energy end of the electromagnetic spectrum. Therefore, it has less energy than other commonly encountered types of non-ionizing radiation like radio waves, infrared radiation, and visible light.

The wide use of electricity results in background levels of ELF EMFs in nearly all locations where people spend time – homes, workplaces, schools, cars, the supermarket, etc. A person's average exposure depends upon the sources they encounter, how close they are to them, and the amount of time they spend there.⁶⁸ As stated above, the average exposure to magnetic fields in the U.S. is estimated to be around one mG or 0.1 μ T, but can vary considerably depending on a person's exposure to EMF from electrical devices and wiring.⁶⁹ At times we are often exposed to much higher ELF magnetic fields, for example when standing three feet from a refrigerator the ELF magnetic field is 6 mG and when standing three feet from a microwave oven the field is about 50 mG.⁷⁰ The strength of these fields diminish quickly with distance from the source, but when surrounded by electricity in our homes and other buildings moving away from

one source moves you closer to another. However, unless you are inside of the fence at a utility-scale solar facility or electrical substation it is impossible to get very close to the EMF sources. Because of this, EMF levels at the fence of electrical substations containing high voltages and currents are considered "generally negligible".^{71,72}

The strength of ELF-EMF present at the perimeter of a solar facility or near a PV system in a commercial or residential building is significantly lower than the typical American's average EMF exposure.^{73,74} Researchers in Massachusetts measured magnetic fields at PV projects and found the magnetic fields dropped to very low levels of 0.5 mG or less, and in many cases to less than background levels (0.2 mG), at distances of no more than nine feet from the residential inverters and 150 feet from the utility-scale inverters.⁷⁵ Even when measured within a few feet of the utility-scale inverter, the ELF magnetic fields were well below the International Commission on Non-Ionizing Radiation Protection's recommended magnetic field level exposure limit for the general public of 2,000 mG.⁷⁶ It is typical that utility scale designs locate large inverters central to the PV panels that feed them because this minimizes the length of wire required and shields neighbors from the sound of the inverter's cooling fans. Thus, it is rare for a large PV inverter to be within 150 feet of the project's security fence.

Anyone relying on a medical device such as pacemaker or other implanted device to maintain proper heart rhythm may have concern about the potential for a solar project to interfere with the operation of his or her device. However, there is no reason for concern because the EMF outside of the solar facility's fence is less than 1/1000 of the level at which manufacturers test for ELF EMF interference, which is 1,000 mG.⁷⁷ Manufacturers of potentially affected implanted devices often provide advice on electromagnetic interference that includes avoiding letting the implanted device get too close to certain sources of fields such as some

household appliances, some walkie-talkies, and similar transmitting devices. Some manufacturers' literature does not mention high-voltage power lines, some say that exposure in public areas should not give interference, and some advise not spending extended periods of time close to power lines.⁷⁸

3. Electric Shock and Arc Flash Hazards

There is a real danger of electric shock to anyone entering any of the electrical cabinets such as combiner boxes, disconnect switches, inverters, or transformers; or otherwise coming in contact with voltages over 50 Volts.⁷⁹ Another electrical hazard is an arc flash, which is an explosion of energy that can occur in a short circuit situation. This explosive release of energy causes a flash of heat and a shockwave, both of which can cause serious injury or death. Properly trained and equipped technicians and electricians know how to safely install, test, and repair PV systems, but there is always some risk of injury when hazardous voltages and/or currents are present. Untrained individuals should not attempt to inspect, test, or repair any aspect of a PV system due to the potential for injury or death due to electric shock and arc flash. The National Electric Code (NEC) requires appropriate levels of warning signs on all electrical components based on the level of danger determined by the voltages and current potentials. The national electric code also requires the site to be secured from unauthorized visitors with either a six-foot chain link fence with three strands of barbed wire or an eight-foot fence, both with adequate hazard warning signs.

4. Fire Safety

The possibility of fires resulting from or intensified by PV systems may trigger concern among the

general public as well as among firefighters. However, concern over solar fire hazards should be limited because only a small portion of materials in the panels are flammable, and those components cannot self-support a significant fire. Flammable components of PV panels include the thin layers of polymer encapsulates surrounding the PV cells, polymer backsheets (framed panels only), plastic junction boxes on rear of panel, and insulation on wiring. The rest of the panel is composed of non-flammable components, notably including one or two layers of protective glass that make up over three quarters of the panel's weight.

Heat from a small flame is not adequate to ignite a PV panel, but heat from a more intense fire or energy from an electrical fault can ignite a PV panel.⁸⁰ One real-world example of this occurred during July 2015 in an arid area of California. Three acres of grass under a thin film PV facility burned without igniting the panels mounted on fixed-tilt racks just above the grass.⁸¹ While it is possible for electrical faults in PV systems on homes or commercial buildings to start a fire, this is extremely rare.⁸² Improving understanding of the PV-specific risks, safer system designs, and updated fire-related codes and standards will continue to reduce the risk of fire caused by PV systems.

PV systems on buildings can affect firefighters in two primary ways, 1) impact their methods of fighting the fire, and 2) pose safety hazard to the firefighters. One of the most important techniques that firefighters use to suppress fire is ventilation of a building's roof. This technique allows superheated toxic gases to quickly exit the building. By doing so, the firefighters gain easier and safer access to the building. Ventilation of the roof also makes the challenge of putting out the fire easier. However, the placement of rooftop PV panels may interfere with ventilating the roof by limiting access to desired venting locations.

New solar-specific building code requirements are working to minimize these concerns. Also, the

latest National Electric Code has added requirements that make it easier for first responders to safely and effectively turn off a PV system. Concern for firefighting a building with PV can be reduced with proper fire fighter training, system design, and installation. Numerous organizations have studied fire fighter safety related to PV. Many organizations have published valuable guides and training programs. Some notable examples are listed below.

- The International Association of Fire Fighters (IAFF) and International Renewable Energy Council (IREC) partnered to create an online training course that is far beyond the PowerPoint click-and-view model. The self-paced online course, “Solar PV Safety for Fire Fighters,” features rich video content and simulated environments so fire fighters can practice the knowledge they’ve learned. www.iaff.org/pvsafetytraining
- [Photovoltaic Systems and the Fire Code](#): Office of NC Fire Marshal
- [Fire Service Training](#), Underwriter’s Laboratory
- [Firefighter Safety and Response for Solar Power Systems](#), National Fire Protection Research Foundation
- [Bridging the Gap: Fire Safety & Green Buildings](#), National Association of State Fire Marshalls
- [Guidelines for Fire Safety Elements of Solar Photovoltaic Systems](#), Orange County Fire Chiefs Association
- [Solar Photovoltaic Installation Guidelines](#), California Department of Forestry & Fire Protection, Office of the State Fire Marshall
- [PV Safety & Firefighting](#), Matthew Paiss, Homepower Magazine
- [PV Safety and Code Development](#): Matthew Paiss, Cooperative Research Network

Summary

The purpose of this paper is to address and alleviate concerns of public health and safety for utility-scale solar PV projects. Concerns of public health and safety were divided and discussed in the four following sections: (1) Toxicity, (2) Electromagnetic Fields, (3) Electric Shock and Arc Flash, and (4) Fire. In each of these sections, the negative health and safety impacts of utility-scale PV development were shown to be negligible, while the public health and safety benefits of installing these facilities are significant and far outweigh any negative impacts.

-
- 1 Wiser, Ryan, Trieu Mai, Dev Millstein, Jordan Macknick, Alberta Carpenter, Stuart Cohen, Wesley Cole, Bethany Frew, and Garvin A. Heath. 2016. On the Path to SunShot: The Environmental and Public Health Benefits of Achieving High Penetrations of Solar Energy in the United States. Golden, CO: National Renewable Energy Laboratory. Accessed March 2017, www.nrel.gov/docs/fy16osti/65628.pdf
 - 2 IRENA and IEA-PVPS (2016), “End-of-Life Management: Solar Photovoltaic Panels,” International Renewable Energy Agency and International Energy Agency Photovoltaic Power Systems.
 - 3 National Renewable Energy Laboratory, *Overview of Field Experience – Degradation Rates & Lifetimes*. September 14, 2015. Solar Power International Conference. Accessed March 2017, www.nrel.gov/docs/fy15osti/65040.pdf
 - 4 Miesel et al. *SolarCity Photovoltaic Modules with 35 Year Useful Life*. June 2016. Accessed March 2017. <http://www.solarcity.com/newsroom/reports/solarcity-photovoltaic-modules-35-year-useful-life>
 - 5 David Unger. *Are Renewables Stormproof? Hurricane Sandy Tests Solar, Wind*. November 2012. Accessed March 2017. <http://www.csmonitor.com/Environment/Energy-Voices/2012/1119/Are-renewables-stormproof-Hurricane-Sandy-tests-solarwind> & <http://www.csmonitor.com/Environment/Energy-Voices/2012/1119/Are-renewables-stormproof-Hurricane-Sandytests-solar-wind>
 - 6 NEXTracker and 365 Pronto, *Tracking Your Solar Investment: Best Practices for Solar Tracker O&M*.

Accessed March 2017.

www.nextracker.com/content/uploads/2017/03/NEX-Tracker_OandM-WhitePaper_FINAL_March-2017.pdf

7 Christiana Honsberg, Stuart Bowden. *Overview of Screen Printed Solar Cells*. Accessed January 2017.

www.pveducation.org/pvcdrom/manufacturing/screen-printed

8 Silicon Valley Toxics Coalition. *2015 Solar Scorecard*. Accessed August 2016.

www.solarscorecard.com/2015/2015-SVTC-Solar-Scorecard.pdf

9 European Commission. *Recast of Reduction of Hazardous Substances (RoHS) Directive*. September 2016. Accessed August 2016.

http://ec.europa.eu/environment/waste/rohs_eee/index_en.htm

10 Official Journal of the European Union, *DIRECTIVE 2011/65/EU OF THE EUROPEAN PARLIAMENT AND OF THE COUNCIL of 8 June 2011 on the restriction of the use of certain hazardous substances in electrical and electronic equipment*. June 2011. Accessed May 2017.

<http://eur-lex.europa.eu/legalcontent/EN/TXT/PDF/?uri=CELEX:32011L0065&from=en>

11 Giancarlo Giacchetta, Mariella Leporini, Barbara Marchetti. *Evaluation of the Environmental Benefits of New High Value Process for the Management of the End of Life of Thin Film Photovoltaic Modules*. July 2013. Accessed August 2016.

www.researchgate.net/publication/257408804_Evaluation_of_the_environmental_benefits_of_new_high_value_process_for_the_management_of_the_end_of_life_of_thin_film_photovoltaic_modules

12 European Commission. *Study on Photovoltaic Panels Supplementing The Impact Assessment for a Recast of the Weee Directive*. April 2011. Accessed August 2016.

<http://ec.europa.eu/environment/waste/weee/pdf/Study%20on%20PVs%20Bio%20final.pdf>

14 The amount of lead in a typical car battery is 21.4 pounds. Waste 360. Chaz Miller. *Lead Acid Batteries*. March 2006. Accessed August 2016.

http://waste360.com/mag/waste_leadacid_batteries_3

15 Okkenhaug G. *Leaching from CdTe PV module material results from batch, column and availability tests*. Norwegian Geotechnical Institute, NGI report No. 20092155-00-6-R; 2010

16 International Journal of Advanced Applied Physics Research. Renate Zapf-Gottwick¹, et al. *Leaching*

Hazardous Substances out of Photovoltaic Modules. January 2015. Accessed January 2016.

www.cosmoscholars.com/phms/index.php/ijaapr/article/download/485/298

17 *ibid*

18 Parikhit Sinha, et al. *Evaluation of Potential Health and Environmental Impacts from End-Of-Life Disposal of Photovoltaics*, Photovoltaics, 2014. Accessed May 2016

19 Bonnet, D. and P. Meyers. 1998. *Cadmium-telluride—Material for thin film solar cells*. J. Mater. Res., Vol. 13, No. 10, pp. 2740-2753

20 V. Fthenakis, K. Zweibel. *CdTe PV: Real and Perceived EHS Risks*. National Center of Photovoltaics and Solar Program Review Meeting, March 24-26, 2003. www.nrel.gov/docs/fy03osti/33561.pdf. Accessed May 2017

21 International Energy Agency Photovoltaic Power Systems Programme. *Life Cycle Inventories and Life Cycle Assessments of Photovoltaic Systems*. March 2015. Accessed August 2016.

<http://iea-pvps.org/index.php?id=315>

22 Data not available on fraction of various generation sources offset by solar generation in NC, but this is believed to be a reasonable rough estimate. The SunShot report entitled *The Environmental and Public Health Benefits of Achieving High Penetrations of Solar Energy in the United States* analysis contributes significant (% not provided) offsetting of coal-fired generation by solar PV energy in the southeast.

23 $7 \text{ MWDC} * 1.5 \text{ GWh/MWDC} * 25 \text{ years} * 0.93 \text{ degradation factor} * (0.1 * 4.65 \text{ grams/GWh} + 0.9 * 0.2 \text{ grams/GWh})$

24 Vasilis Fthenakis. *CdTe PV: Facts and Handy Comparisons*. January 2003. Accessed March 2017.

https://www.bnl.gov/pv/files/pdf/art_165.pdf

25 Kaczmar, S., *Evaluating the Read-Across Approach on CdTe Toxicity for CdTe Photovoltaics*, SETAC North America 32nd Annual Meeting, Boston, MA, November 2011. Available at:

<ftp://ftp.co.imperial.ca.us/icpds/eir/campo-verdesolar/final/evaluating-toxicity.pdf>, Accessed May 2017

27 V. M. Fthenakis et al, *Emissions and Encapsulation of Cadmium in CdTe PV Modules During Fires* Renewable Progress in Photovoltaics: Research and Application: Res. Appl. 2005; 13:1–11, Accessed March 2017, www.bnl.gov/pv/files/pdf/abs_179.pdf

28 Fthenakis V.M., *Life Cycle Impact Analysis of Cadmium in CdTe Photovoltaic Production*, Renewable

- and Sustainable Energy Reviews, 8, 303-334, 2004. www.clca.columbia.edu/papers/Life_Cycle_Impact_Analysis_Cadmium_CdTe_Photovoltaic_production.pdf, Accessed May 2017
- 29 International Renewable Energy Agency. Stephanie Weckend, Andreas Wade, Garvin Heath. *End of Life Management: Solar Photovoltaic Panels*. June 2016. Accessed November 2016.
- 30 International Journal of Advanced Applied Physics Research. Renate Zapf-Gottwick¹, et al. *Leaching Hazardous Substances out of Photovoltaic Modules*. January 2015. Accessed January 2016. www.cosmoscholars.com/phms/index.php/ijaapr/article/download/485/298
- 31 Cunningham D., Discussion about TCLP protocols, Photovoltaics and the Environment Workshop, July 23-24, 1998, Brookhaven National Laboratory, BNL-52557
- 32 Parikhit Sinha, et al. Evaluation of Potential Health and Environmental Impacts from End-Of-Life Disposal of Photovoltaics, Photovoltaics, 2014. Accessed May 2016
- 33 Practical Handbook of Photovoltaics: Fundamentals and Applications. T. Markvart and L. Castaner. *Chapter VII-2: Overview of Potential Hazards*. December 2003. Accessed August 2016. https://www.bnl.gov/pv/files/pdf/art_170.pdf
- 34 Norwegian Geotechnical Institute. *Environmental Risks Regarding the Use and End-of-Life Disposal of CdTe PV Modules*. April 2010. Accessed August 2016. <https://www.dtsc.ca.gov/LawsRegsPolicies/upload/Norwegian-Geotechnical-InstituteStudy.pdf>
- 35 First Solar. Dr. Yasunari Matsuno. December 2013. August 2016. *Environmental Risk Assessment of CdTe PV Systems to be considered under Catastrophic Events in Japan*. http://www.firstsolar.com/-/media/Documents/Sustainability/PeerReviews/Japan_Peer-Review_Matsuno_CdTe-PV-Tsunami.ashx
- 36 First Solar. Parikhit Sinha, Andreas Wade. *Assessment of Leaching Tests for Evaluating Potential Environmental Impacts of PV Module Field Breakage*. 2015 IEEE
- 37 See p. 22 of First Solar, Sustainability Report. Available at: www.firstsolar.com/-/media/FirstSolar/Sustainability-Documents/03801_FirstSolar_SustainabilityReport_08MAR16_Web.ashx. Accessed May 2017
- 38 40 CFR §261.24. *Toxicity Characteristic*. May 2017. Accessed May 2017. https://www.ecfr.gov/cgi-bin/textidx?node=se40.26.261_124&rgn=div8
- 39 Office of Energy Efficiency & Renewable Energy. *Copper Indium Gallium Diselenide*. Accessed March 2017. <https://www.energy.gov/eere/sunshot/copper-indium-gallium-diselenide>
- 40 Mathias Maehlum. *Best Thin Film Solar Panels – Amorphous, Cadmium Telluride or CIGS?* April 2015. Accessed March 2017. <http://energyinformative.org/best-thin-film-solar-panels-amorphous-cadmium-telluride-cigs/>
- 41 RoHS tested certificate for Solar Frontier PV modules. TUV Rheinland, signed 11.11.2013
- 42 International Renewable Energy Agency. Stephanie Weckend, Andreas Wade, Garvin Heath. *End of Life Management: Solar Photovoltaic Panels*. June 2016. Accessed November 2016. http://www.irena.org/DocumentDownloads/Publications/IRENA_IEAPVPS_End-of-Life_Solar_PV_Panels_2016.pdf
- 43 40 C.F.R. §261.10. *Identifying the Characteristics of Hazardous Waste and for Listing Hazardous Waste*. November 2016. Accessed November 2016 <http://www.ecfr.gov/cgi-bin/textidx?SID=ce0006d-66da40146b490084ca2816143&mc=true&node=pt40.26.261&rgn=div5#sp40.28.261.b>
- 44 40 C.F.R. §261.24 *Toxicity Characteristic*. November 2016. Accessed November 2016. http://www.ecfr.gov/cgi-bin/textidx?SID=ce0006d-66da40146b490084ca2816143&mc=true&node=pt40.26.261&rgn=div5#se40.28.261_124
- 45 International Renewable Energy Agency. Stephanie Weckend, Andreas Wade, Garvin Heath. *End of Life Management: Solar Photovoltaic Panels*. June 2016. Accessed November 2016. http://www.irena.org/DocumentDownloads/Publications/IRENA_IEAPVPS_End-of-Life_Solar_PV_Panels_2016.pdf
- 46 TLCP test results from third-party laboratories for REC, Jinko, and Canadian Solar silicon-based panels. Provided by PV panel manufacturers directly or indirectly to authors
- 47 Sinovoltaics, Introduction to *Solar Panel Recycling*, March 2014. Accessed October 2016. <http://sinovoltaics.com/solarbasics/introduction-to-solar-panel-recycling/>
- 48 Brookhaven National Laboratory. Vasilis Fthenakis,

Regulations on Photovoltaic Module Disposal and Recycling. January 29, 2001.

49 Parikhit Sinha, et al. Evaluation of Potential Health and Environmental Impacts from End-Of-Life Disposal of Photovoltaics, Photovoltaics, 2014.

50 First Solar. Parikhit Sinha, Andreas Wade. *Assessment of Leaching Tests for Evaluating Potential Environmental Impacts of PV Module Field Breakage*. October 2015. Accessed August 2016.

<http://www.firstsolar.com/-/media/Documents/Sustainability/PVSC42-Manuscript-20150912--Assessment-of-Leaching-Tests-for-Evaluating-Potential-Environmental-Impa.ashx>

51 First Solar. Dr. Yasunari Matsuno. December 2013. *Environmental Risk Assessment of CdTe PV Systems to be considered under Catastrophic Events in Japan*.

http://www.firstsolar.com/-/media/Documents/Sustainability/PeerReviews/Japan_Peer-Review_Matsuno_CdTe-PV-Tsunami.ashx

52 Phone interview, February 3, 2016, TT&E Iron & Metal, Garner, NC www.ncscrapmetal.com

53 Wen-His Huang, et al. *Strategy and Technology To Recycle Water-silicon Solar Modules*. Solar Energy, Volume 144, March 2017, Pages 22-31

54 International Renewable Energy Agency. Stephanie Weckend, Andreas Wade, Garvin Heath. *End of Life Management: Solar Photovoltaic Panels*. June 2016. Accessed November 2016.

http://www.irena.org/DocumentDownloads/Publications/IRENA_IEAPVPS_End-of-Life_Solar_PV_Panels_2016.pdf

55 Official Journal of the European Union. *Directive 2012/19/EU of the European Parliament and of the Council of 4 July 2012 on Waste Electrical and Electronic Equipment*. July 2012. Accessed November 2016.

<http://eurlex.europa.eu/legal-content/EN/TXT/?uri=cellex%3A32012L0019>

56 PV CYCLE. *Annual Report 2015*. Accessed November 2016.

<https://pvcyclepublications.cld.bz/Annual-Report-PV-CYCLE-2015/6-7>

57 Official Journal of the European Union. *Directive 2012/19/EU of the European Parliament and of the Council of 4 July 2012 on Waste Electrical and Electronic Equipment*. July 2012. Accessed November 2016.

<http://eurlex.europa.eu/legal-content/EN/TXT/?uri=cellex%3A32012L0019>

58 SEIA National PV Recycling Program:

www.seia.org/seia-national-pv-recycling-program

59 RBI Solar, Decommissioning Plan submitted to Catawba County associated with permitting of a 5MW solar project in June 2016. Accessed April 2017.

www.catawbacountync.gov/Planning/Projects/Rezoning/RZ2015-05_DecommissioningPlan.pdf

60 Birdseye Renewables, Decommissioning Plan submitted to Catawba County associated with permitting of a 5MW solar project in May 2015. Accessed April 2017.

www.catawbacountync.gov/Planning/Projects/Rezoning/RZ2015-04_DecommissioningPlan.pdf

61 Cypress Creek Renewables, Decommissioning Plan submitted to Catawba County associated with permitting of a 5MW solar project in September 2016. Accessed April 2017.

www.catawbacountync.gov/Planning/Projects/Rezoning/RZ2016-06decommission.pdf

62 Sun Raised Farms:

<http://sunraisedfarms.com/index.html>

63 National Institute of Environmental Health Sciences and National Institutes of Health, EMF: Electric and Magnetic Fields Associated with Electric Power: Questions and Answers, June 2002

64 World Health Organization. *Electromagnetic Fields and Public Health: Exposure to Extremely Low Frequency Fields*. June 2007. Accessed August 2016.

<http://www.who.int/peh-emf/publications/facts/fs322/en/>

65 Committee on the Possible Effects of Electromagnetic Fields on Biologic Systems, National Research Council, Possible Health Effects of Exposure to Residential Electric and Magnetic Fields, ISBN: 0-309-55671-6, 384 pages, 6 x 9, (1997) This PDF is available from the National Academies Press at:

<http://www.nap.edu/catalog/5155.html>

66 World Health Organization. *Electromagnetic Fields and Public Health: Exposure to Extremely Low Frequency Fields*. June 2007. Accessed August 2016.

<http://www.who.int/peh-emf/publications/facts/fs322/en/>

67 World Health Organization. *Electromagnetic Fields and Public Health: Static Electric and Magnetic Fields*. March 2006. Accessed August 2016.

<http://www.who.int/peh-emf/publications/facts/fs299/en/>

68 Asher Sheppard, Health Issues Related to the Static and Power-Frequency Electric and Magnetic Fields (EMFs) of the Soitec Solar Energy Farms, April

30, 2014. Accessed March 2017:

www.sandiegocounty.gov/content/dam/sdc/pds/ceqa/Soitec-Documents/Final-EIR-Files/Appendix_9.0-1_EMF.pdf

69 Massachusetts Clean Energy Center. *Study of Acoustic and EMF Levels from Solar Photovoltaic Projects*. December 2012. Accessed August 2016.

70 Duke Energy Corporation. *Frequently Asked Questions: Electric and Magnetic Fields*. Accessed August 2016.

https://www.duke-energy.com/about-energy/frequently_asked_questions.asp

71 National Institute of Environmental Health Sciences, *Electric and Magnetic Fields Associate with the use of Electric Power: Questions and Answers*, 2002. Accessed November 2016

www.niehs.nih.gov/health/materials/electric_and_magnetic_fields

72 Duke Energy Corporation. *Frequently Asked Questions: Electric and Magnetic Fields*. Accessed August 2016.

https://www.duke-energy.com/about-energy/frequently_asked_questions.asp

73 R.A. Tell et al, *Electromagnetic Fields Associated with Commercial Solar Photovoltaic Electric Power Generating Facilities*, *Journal of Occupational and Environmental Hygiene*, Volume 12, 2015,- Issue 11. Abstract Accessed March 2016:

<http://www.tandfonline.com/doi/full/10.1080/15459624.2015.1047021>

74 Massachusetts Department of Energy Resources,

Massachusetts Department of Environmental Protection, and Massachusetts Clean Energy Center. *Questions & Answers: Ground-Mounted Solar Photovoltaic Systems*. June 2015. Accessed August 2016.

<http://www.mass.gov/eea/docs/doer/renewables/solar/solar-pv-guide.pdf>

75 Ibid.

76 Ibid.

77 *EMFs and medical devices*, Accessed March 2017.

www.emfs.info/effects/medical-devices/

78 Ibid.

79 Damon McCluer. *Electrical Construction & Maintenance: NFPA 70E's Approach to Considering DC Hazards*. September 2013. Accessed October 2016.

<http://ecmweb.com/safety/nfpa-70e-s-approach-considering-dc-hazards>

80 Hong-Yun Yang, et. al. *Experimental Studies on the Flammability and Fire Hazards of Photovoltaic Modules, Materials*. July 2015. Accessed August 2016.

<http://www.mdpi.com/1996-1944/8/7/4210/pdf>

81 Matt Fountain. The Tribune. *Fire breaks out at Topaz Solar Farm*. July 2015. Accessed August 2016.

www.sanluisobispo.com/news/local/article39055539.html

82 Cooperative Research Network. Matthew Paiss. *Tech Surveillance: PV Safety & Code Developments*. October 2014. Accessed August 2016.

http://www.nreca.coop/wp-content/uploads/2013/06/ts_pv_fire_safety_oct_2014.pdf



“Clean Energy in Michigan” Series, Number 12

Facts about solar panels: PFAS contamination

By Dr. Annick Anctil, Michigan State University

Q: Do solar panels contribute to PFAS contamination?

Multiple states have raised concerns about PFAS contamination from solar farms, largely citing academic research on how PFAS could *potentially* be used in photovoltaic (PV) solar panels.¹ The fact is that PFAS is *not* customarily used in solar panels because safer, effective alternatives have already been developed and commercialized. Moreover, no studies have shown the presence or leaching of PFAS from PV panels—either while they are in active use or at the end of their life (e.g., in a landfill).

Anatomy of a solar panel

These three parts of a solar panel cause confusion about the presence of PFAS.

Self-Cleaning Coat

A self-cleaning coating on the top of a solar panel helps reduce dust, pollen, and snow adhesion, extending both the power output and the lifetime of the panel.² Multiple self-cleaning coating options are available on the market, many of which make use of non-hazardous silicon-based chemistry.³ Confusion comes from the fact that some other commercialized self-cleaning coating options do make use of PFAS-based chemicals, although even those do not degrade under normal use.

Adhesives

PV panels are sealed from the elements to maximize power output and lifetime. While PFAS chemicals are found in certain adhesives, such as carpentry glues, they are not typically used in sealant adhesives for solar panels.⁴ Instead, solar adhesives are based on silicone polymers, which are well known for their lack of negative health impacts and remarkable stability.⁵

Substrate

PV modules are housed in a weather-resistant substrate that offers additional protection from the elements. Thin-film PV units use glass as the substrate, while crystalline silicon PV units use a polymer substrate, which has led to the rumors of

Solar Panels. Photo by Mariana Proenca on Unsplash



MICHIGAN DEPARTMENT OF
ENVIRONMENT, GREAT LAKES, AND ENERGY



GRAHAM
SUSTAINABILITY INSTITUTE
UNIVERSITY OF MICHIGAN

Acknowledgement

This material is based upon work supported by the Department of Energy and the Michigan Energy Office (MEO) under Award Number EE00007478.

The Clean Energy in Michigan series provides case studies and fact sheets answering common questions about clean energy projects in Michigan.

Find this document and more about the project online at graham.umich.edu/climate-energy/energy-futures.

potential PFAS use in solar panels. The most common polymer used in silicon PV units is Tedlar, a weather resistant polymer that is not a PFAS compound itself and makes no use of PFAS during its manufacturing process.⁶ Far more common materials, like those used in construction projects and weather resistant fabrics, present a higher risk of PFAS exposure than PV. In fact, a recent study found that these more common materials release PFAS under conditions where solar panels do not, indicating that PFAS exposure risk may be higher sitting on outdoor furniture, for example, than living next to a solar farm.⁷

What is PFAS anyway?

Per/Poly Fluoro-Alkyl Substances, PFAS for short, are a class of chemical compounds. PFAS are used in several industries for their unique properties, notably their ability to create coatings that are highly water repellent.

PFAS are extremely persistent within the environment, not breaking down over time. Certain PFAS compounds have been linked to human health issues—notably low infant birth weights, increased risk of certain cancers, and thyroid issues. As a result of their persistence and toxicity, those PFAS compounds that pose a significant risk have been banned from use and production, and subsequently replaced with safer alternatives.

It's important to note that not all PFAS compounds are dangerous. Some PFAS compounds, such as Teflon, are much more stable and present no risk to human health under normal conditions of use.⁸

-
- 1 S. Maharjan *et al.*, "Self-cleaning hydrophobic nanocoating on glass: A scalable manufacturing process," *Mater. Chem. Phys.*, vol. 239, Jan. 2020.; . Son *et al.*, "A practical superhydrophilic self cleaning and antireflective surface for outdoor photovoltaic applications," *Sol. Energy Mater. Sol. Cells*, 2012.; H. C. Han *et al.*, "Enhancing efficiency with fluorinated interlayers in small molecule organic solar cells," *J. Mater. Chem.*, vol. 22, no. 43, 2012.
 - 2 "How a solar cell works – American Chemical Society." [Online]; H. C. Han *et al.*, "Enhancing efficiency with fluorinated interlayers in small molecule organic solar cells," *J. Mater. Chem.*, vol. 22, no. 43, 2012.; M. Simon and E. L. Meyer, "Detection and analysis of hot-spot formation in solar cells," *Solar Energy Materials and Solar Cells*. pp. 106–113, 2010.
 - 3 "Say Goodbye To Solar Panel Cleaning | Ultimate Efficiency | Solar Sharc®." [Online].
 - 4 "Electronics Product Catalog | Dow Inc." [Online]; B. J. Henry *et al.*, "A critical review of the application of polymer of low concern and regulatory criteria to fluoropolymers," *Integrated Environmental Assessment and Management*, vol. 14, no. 3. pp. 316–334, May-2018.
 - 5 "Electronics Product Catalog | Dow Inc."; "Properties of Silicones." [Online]; A. M. Bueche, "The curing of silicone rubber with benzoyl peroxide," *J. Polym. Sci.*, vol. 15, no. 79, pp. 105–120, Jan. 1955.
 - 6 M. H. Alaaeddin, S. M. Sapuan, M. Y. . Zuhri, E. . Zainudin, and F. M. AL-Oqla, "Polyvinyl fluoride (PVF); Its Properties, Applications, and Manufacturing Prospects," *IOP Conf. Ser. Mater. Sci. Eng.*, vol. 538, p. 012010, Jun. 2019.
 - 7 R. M. Janousek, S. Lebertz, and T. P. Knepper, "Previously unidentified sources of perfluoroalkyl and polyfluoroalkyl substances from building materials and industrial fabrics," *Environ. Sci. Process. Impacts*, vol. 21, no. 11, pp. 1936–1945, Nov. 2019.
 - 8 "Per- and Polyfluoroalkyl Substances (PFAS) | US EPA." [Online].; B. J. Henry *et al.*, "A critical review of the application of polymer of low concern and regulatory criteria to fluoropolymers"

Health and Safety Impacts of Solar Photovoltaics:

A California-Focused Forward to the Health and Safety Impacts of Solar Photovoltaics white paper published by the N.C. Clean Energy Technology Center at North Carolina State University in May 2017

By: Thomas H. Cleveland, P.E., lead author of the North Carolina white paper

RE: Soscol Ferry Road Solar, a proposed 1.98 MW_{AC} PV facility in Napa, CA

Date: July 31, 2019

For the last several years North Carolina (NC) has trailed only California in the capacity of annual solar photovoltaic (PV) installed. For most of that time North Carolina's PV development was nearly entirely distribution-connected ground-mounted solar facilities, most commonly 5 MW_{AC} projects. More recently, North Carolina is developing a mixture of transmission-connected PV facilities between 20 and 75 MW_{AC} and distribution-connected facilities of 1 to 5 MW_{AC}, but still has relatively few commercial or residential PV projects. As the state quickly transitioned from zero utility-scale solar facilities to over 400 utility-scale solar facilities concerns about the health and safety impacts of photovoltaics were raised at countless public hearings across the state and in many meetings of state officials and regulators, including several NC general assembly committee meetings. These concerns led to several years of engagement on this topic by the NC Clean Energy Technology Center at North Carolina State University that resulted in a detailed, peer-reviewed university white paper on the latest scientific understanding regarding PV health and safety impacts, with a focus on North Carolina.

Naturally, there is also interest in the potential health and safety impacts of PV in California, where there is significantly more installed solar capacity than in North Carolina, in a mixture of residential, commercial, and small- and large-scale ground-mounted utility-scale solar projects. While there are massive similarities between the PV installations and their potential health and safety impacts in each state, there are some differences in policy, climate, industry practices, electricity regulation, and more that are worth highlighting. This forward is an attempt by the lead researcher and author of the North Carolina white paper to provide a supplement to the original paper that clearly demonstrates the applicability of the paper to PV in California and to offer California-specific supplements or modifications where the original paper had a North Carolina focus.

Most importantly, all the white paper's conclusions about the negligible negative health and safety impacts of photovoltaics apply fully in California, as well as anywhere in the United States. Similarly, there is nothing unique about the 1.98 MW_{AC} Soscol Ferry Road Solar project that would cause any health or safety impacts different than those discussed in the N.C. white paper.

Throughout the white paper there are instances of North Carolina-specific information, or issues where the situation in California is different than it is in North Carolina. The following is a list of the significant instances of either situation, in the order they appear in the white paper, along with the relevant California-specific information.

- Type of PV Technology Used: Crystalline silicon, Cadmium Telluride (CdTe), and CIGS are all being installed in California as they are in N.C. Since the publication of the N.C. report the author has confirmed the recent installation of utility-scale projects using CIGS modules, but these are still not common. Like in NC, the majority of the current PV installation capacity in California is crystalline silicon, also like NC these are generally Tier I modules. The Soscol Ferry Rd. project will use Tier I crystalline silicon modules.
- Design Wind Speed: The ASCE 7-2016 design wind speed in the vast majority of California, including in Napa County where the Soscol Ferry Road Solar project is located, is 90-95 MPH, which is much lower than the design wind speeds of hurricane-prone eastern N.C. where most PV development in the state is located. A few mountainous regions of California have design wind speeds over 100 MPH, however these extreme

terrains are unlikely to install ground-mounted PV systems.

- Offset Electricity Fuel Mix: The white paper includes a rough estimation that the fuel mix of the generators offset by PV energy production in N.C. is 90% natural gas and 10% coal. From this mix an estimate of the reduction in cadmium emissions due to PV was calculated. The 10% coal estimate is certainly too high for California. An offset fuel mix for California could be reasonably estimated as 100% natural gas, resulting in about 75% of the cadmium emissions savings calculated for NC.
- PV Module Recycling: The white paper included local reports from PV developers in North Carolina of recycling damaged PV modules. It is quite possible that the same is occurring in California, but the author does not have data on the current common waste management practices for damaged PV modules in California. The Electric Power Research Institute (EPRI) published two extensive reports on the Photovoltaic Module Recycling in the United States (April 2018) and Insights in Photovoltaic Recycling Processes in Europe (December 2017), which are great sources for current information on PV module recycling. The EPRI report on recycling in the U.S. states that there are commercial recyclers in the U.S. accepting and recycling PV modules, using processes not unlike those described in the white paper.
- PV Module Washing: Unlike North Carolina, many regions of California regularly experience long periods of time with little to no rain, which can result in enough accumulation of dirt on the PV modules that it justifies occasionally washing the modules to renew their performance. In North Carolina there is generally a heavy rain often enough to keep the panels clean enough to not require manual panel washing. This difference does not have an impact on the health or safety impact of the photovoltaic modules other than perhaps some increased risk of electric shock when washing the modules. Proper installation, maintenance, and washing techniques should reduce this risk to near zero.
- Vegetation Maintenance: The climate in many regions of California, including Napa County where the Soscol Ferry Road Solar project is located, cause the growth of vegetation requiring maintenance to be less vigorous than the vegetation in moist North Carolina. Thus, PV sites in California use similar vegetation maintenance techniques to North Carolina however they need to spend less time and make fewer trips to adequately maintain vegetation on site.
- California Hazardous Waste Policy:
 - As explained in the white paper, in the United States a waste material is considered hazardous waste if the results of a Toxicity Characteristic Leaching Procedure (TCLP) test find concentrations of any of 40 hazardous chemicals above the allowed EPA concentration limit for that chemical. However, in California, materials must additionally meet the more stringent Hazardous Waste Control Law (HWCL), which is like the Reduction of Hazardous Substances (ROHS) directive, adopted in February 2003 by the European Union (EU).ⁱ
 - In 2015, California passed SB-489 directing the CA DTSC (Department of Toxic Substances Control) to write rules to reclassify PV modules as universal waste, even if they fail TCLP. These rules exclude physically damaged, fractured, or fragmented PV modules that are no longer recognizable as PV modules.ⁱⁱ A primary goal of the legislation is to allow producers of waste PV modules to avoid difficult and costly waste determination procedures. In April 2019 the CA DTSC proposed rules to implement SB-489. After the public comment period that ended in June 2019 DTSC may adjust and adopt the rules.ⁱⁱⁱ

ⁱ *Program on Technology Innovation: Feasibility Study on Photovoltaic Module Recycling in the United States, Technical Update, April 2018*; Electric Power Research Institute (EPRI); April 2018.

ⁱⁱ *ibid*

ⁱⁱⁱ (webpage) Beveridge & Diamond law firm; News alert: California Department of Toxic Substances Control Proposes Regulation Classifying Discarded Solar Panels as Universal Waste ; <https://www.bdlaw.com/publications/california-department-of-toxic-substances-control-proposes-regulation-classifying-discarded-solar-panels-as-universal-waste/> (last accessed 7/22/2019)